

Crestron **TST-600-DSW-BBI**  
Wall Mount Back Box for TST-600-DSW  
International Version

---

Installation Guide



# Contents

|   |          |
|---|----------|
| <b>Wall Mount Back Box for TST-600-DSW International Version: TST-600-DSW-BBI</b> | <b>1</b> |
| Description.....  | 1        |
| Installation .....  | 3        |
| Resources.....  | 4        |
| Further Inquiries .....   | 4        |
| Future Updates .....  | 4        |

Product warranty can be found at [www.crestron.com/warranty](http://www.crestron.com/warranty).

The specific patents that cover Crestron products are listed at [patents.crestron.com](http://patents.crestron.com).

Crestron and the Crestron logo are either trademarks or registered trademarks of Crestron Electronics, Inc. in the United States and/or other countries. Other trademarks, registered trademarks, and trade names may be used in this document to refer to either the entities claiming the marks and names or their products. Crestron disclaims any proprietary interest in the marks and names of others. *Crestron is not responsible for errors in typography or photography.*

This document was written by the Technical Publications department at Crestron.  
©2014 Crestron Electronics, Inc.

# Wall Mount Back Box for TST-600-DSW International Version: TST-600-DSW-BBI

---

## Description

The TST-600-DSW-BBI provides a recess wall-mounted metal back box for the Crestron® TST-600-DSW Wall Mount Docking Station and the TST-600-WALL and TST-602-WALL Wall Mount Wireless Touch Screens. It is designed for installation in concrete and masonry applications. Conduit knockouts are provided on the top and bottom.

---

**NOTE:** If mounting in a surface other than a solid material (for example, drywall), Crestron offers a variety of pre-construction and post-construction mounting options. For pre-construction applications, use the TST-600-DSW-BB or TST-600-DSW-PMK. For post-construction applications, use the TST-600-DSW-WMKM or TST-600-DSW-WMKT.


---

**NOTE:** Depending on the installation, forced ventilation may be required.

---

The dimensions of the TST-600-DSW-BBI are shown in the following illustrations.

*TST-600-DSW-BBI Overall Dimensions (Top, Front and Side Views)*

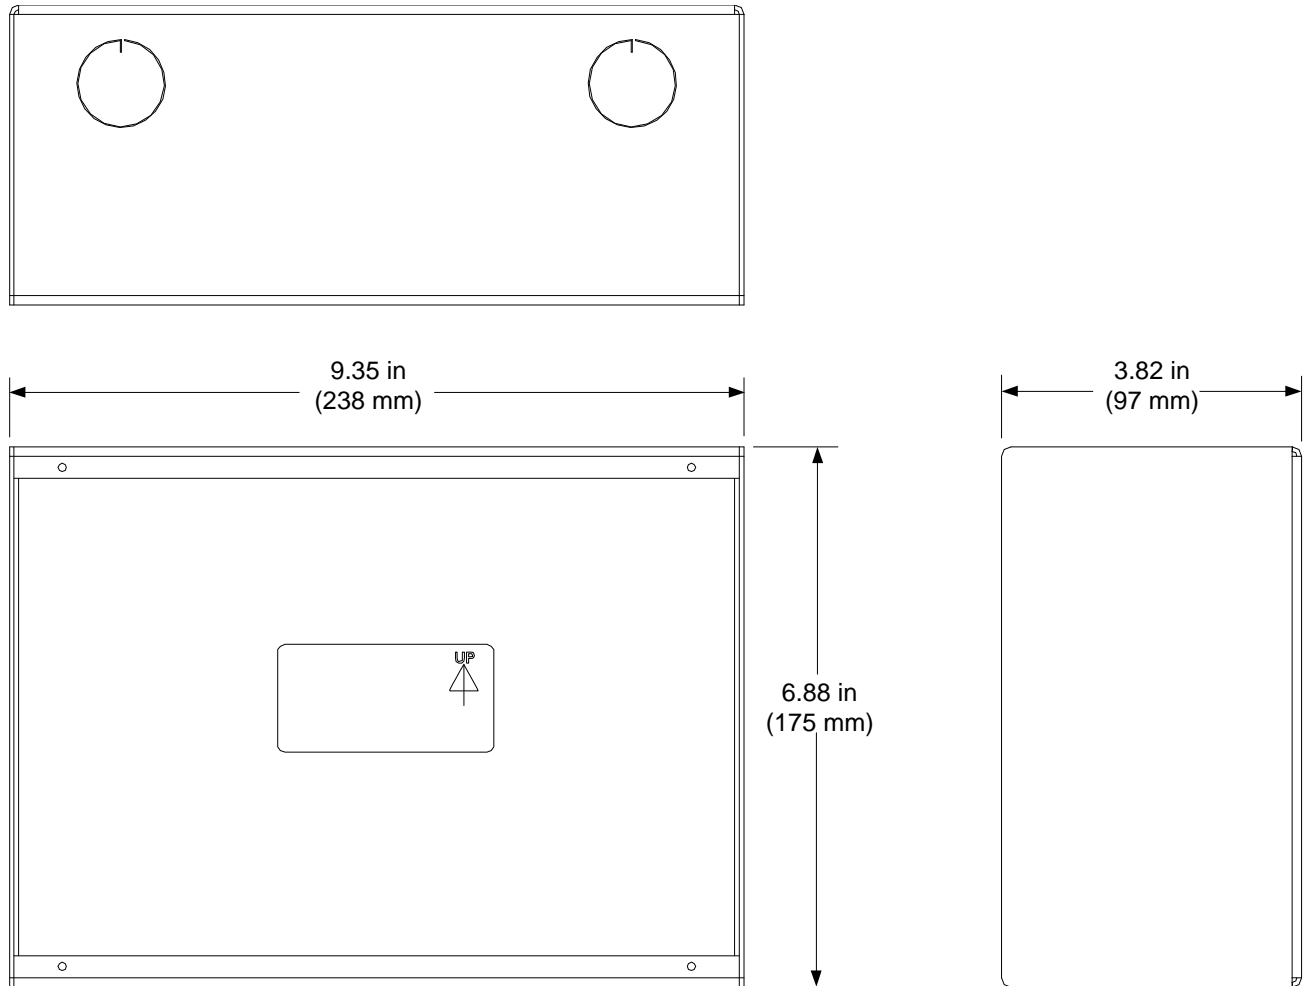

---

**NOTE:** Knockout holes are intended for Class 2 wiring only and are 29 mm (1 1/8") diameter.

---

## Installation

The hardware supplied with the TST-600-DSW-BBI is listed in the following table.


*Supplied Hardware for the TST-600-DSW-BBI*

| DESCRIPTION                       | PART NUMBER | QUANTITY |
|-----------------------------------|-------------|----------|
| Assembly, Back Box, International | 4508551     | 1        |
| Screw, #06-32 x 1 1/2", Pan, Phil | 2007254     | 4        |

Make sure the arrow on the label inside the back box is facing upward. Mount the TST-600-DSW-BBI as shown in the illustration below. Depending on the installation, forced ventilation may be required.

**NOTE:** Remove the appropriate knockouts before installation.

*Mounting the TST-600-DSW-BBI (Exploded View)*

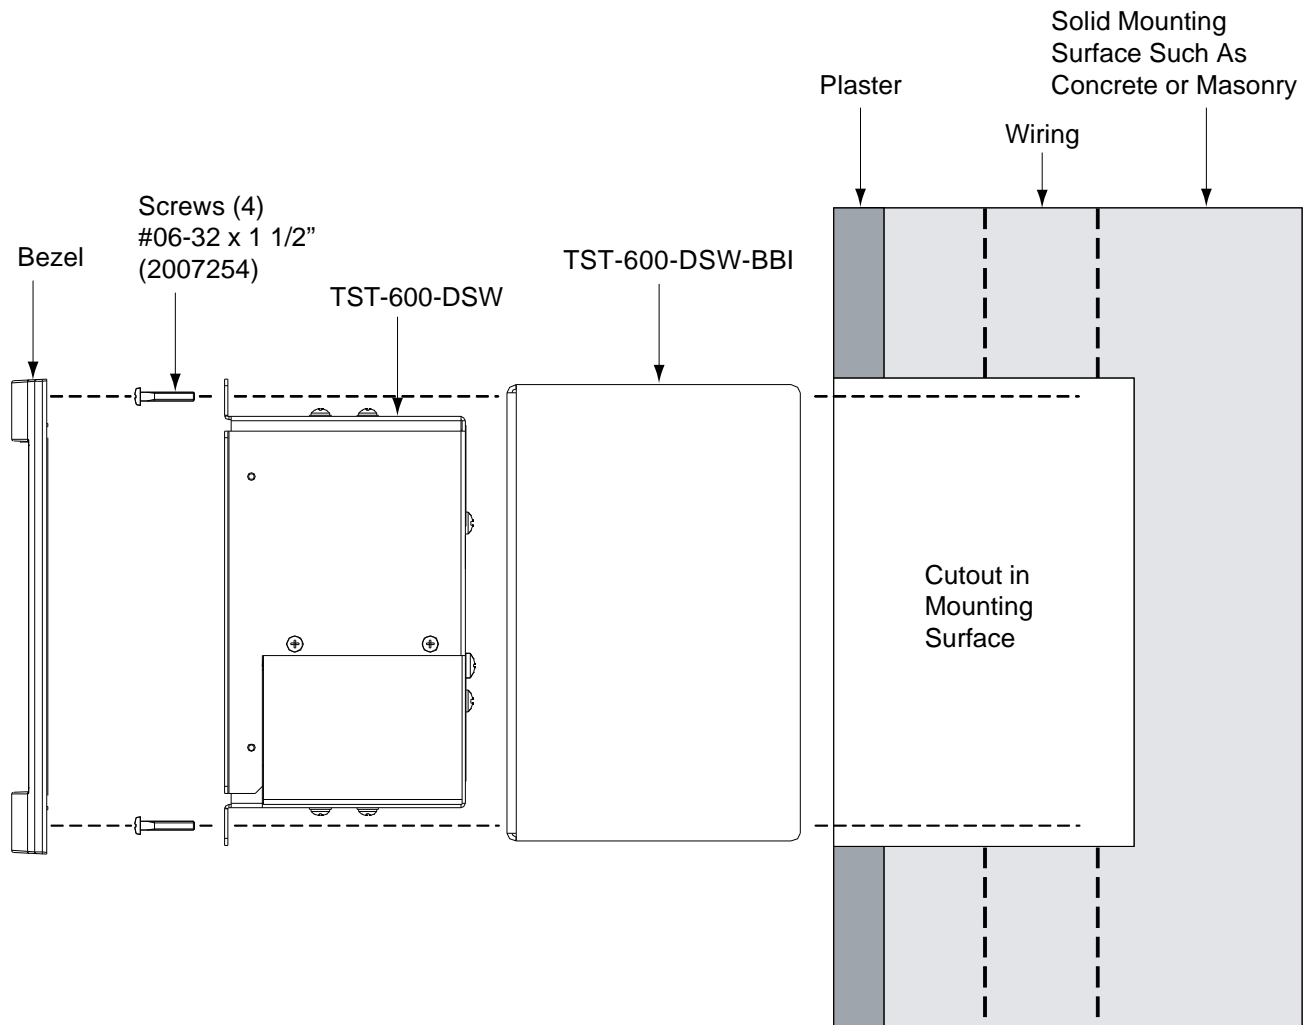

---

## Resources

### Further Inquiries

To locate specific information or resolve questions after reviewing this guide, contact Crestron's True Blue Support at 1-888-CRESTRON [1-888-273-7876] or, for assistance within a particular geographic region, refer to the listing of Crestron worldwide offices at [www.crestron.com/offices](http://www.crestron.com/offices).

To post a question about Crestron products, log onto Crestron's Online Help at [www.crestron.com/onlinehelp](http://www.crestron.com/onlinehelp). First-time users must establish a user account to fully benefit from all available features.

### Future Updates

As Crestron improves functions, adds new features, and extends the capabilities of the TST-600-DSW-BBI, additional information may be made available as manual updates. These updates are solely electronic and serve as intermediary supplements prior to the release of a complete technical documentation revision.

Check the Crestron website periodically for manual update availability and its relevance. Updates are identified as an "Addendum" in the Download column.

This page is intentionally left blank.



**Crestron Electronics, Inc.**  
15 Volvo Drive Rockleigh, NJ 07647  
Tel: 888.CRESTRON  
Fax: 201.767.7576  
[www.crestron.com](http://www.crestron.com)



**Installation Guide – DOC. 7454B  
(2035128)**

**12.14**

Specifications subject to  
change without notice.